


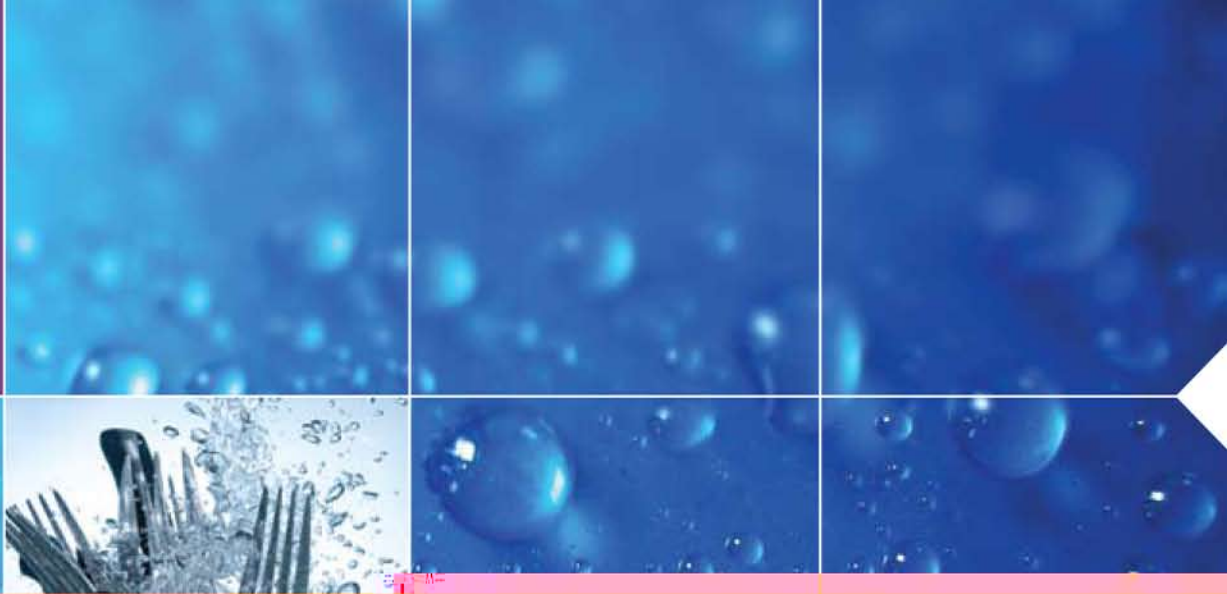

# Performa Cv Control Valves

742 Time Clock

762 Demand

764 Demand

residential

commercial

industrial

marine

aviation




## Electrical

All Controllers require the use of a Pentair Water-supplied transformer.


Transformer Output Voltage 12 Volt – AC 400mA

Transformer Input Options: 115 Volt, 100-50/60 Hz, 220 V

[illegible]

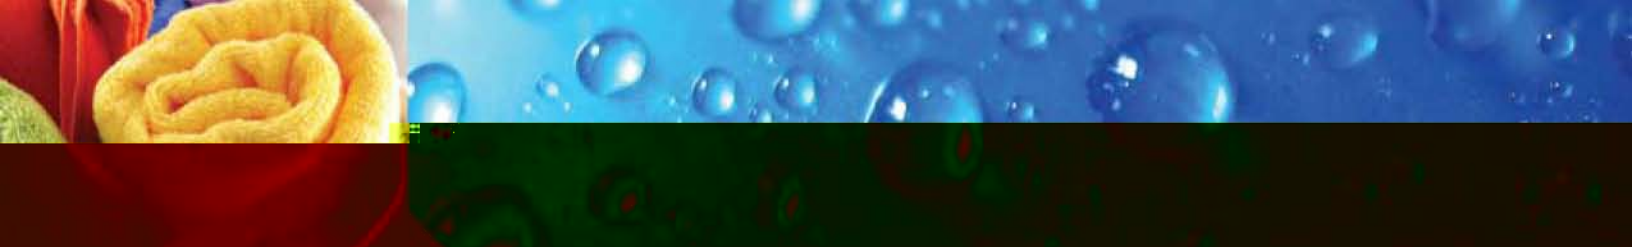


| Flow Rate (gpm) | Pressure Drop (psi) - 100 ft. pipe | Pressure Drop (psi) - 10 ft. pipe | Pressure Drop (psi) - 100 ft. pipe (10 ft. section highlighted) |
|-----------------|------------------------------------|-----------------------------------|-----------------------------------------------------------------|
| 2.2             | 8.3                                | 2.2                               | -                                                               |
| 2.7             | 10.2                               | -                                 | -                                                               |
| 3.9             | 14.76                              | -                                 | 14.76                                                           |
| 4.5             | 17.0                               | -                                 | -                                                               |

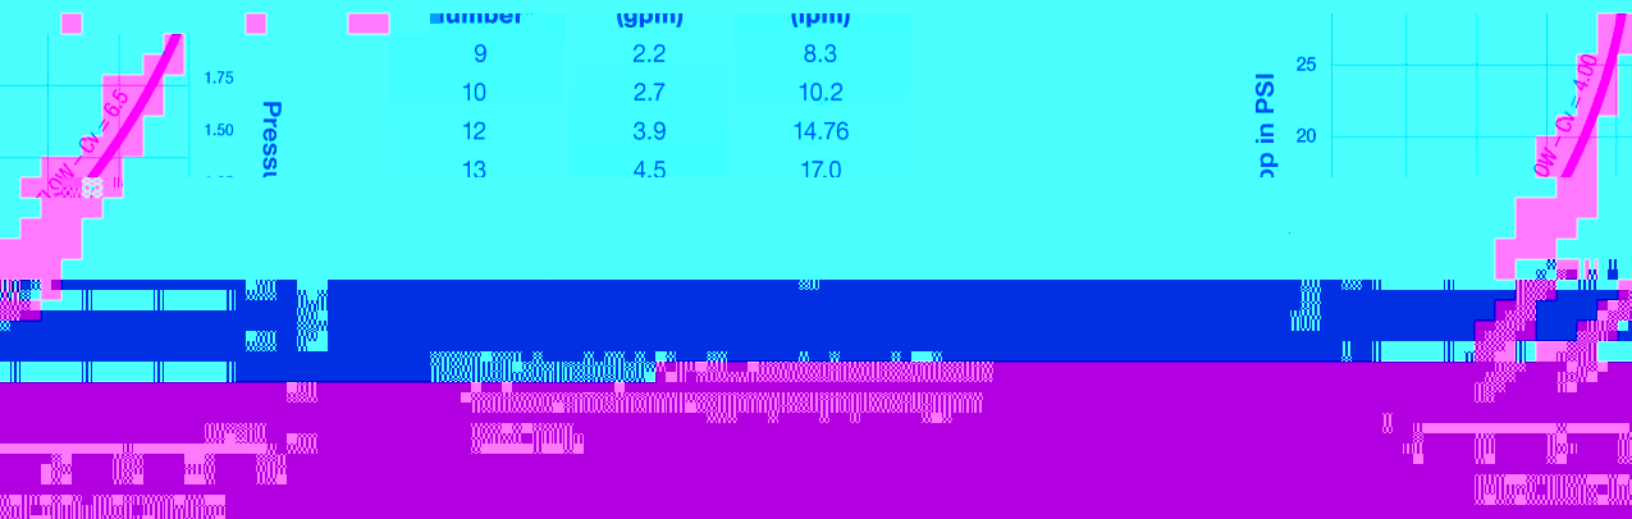


# Injector\* Performance

## Logix™ Series Controllers

Injector "H" (Light Purple)  
For 9-inch Tanks

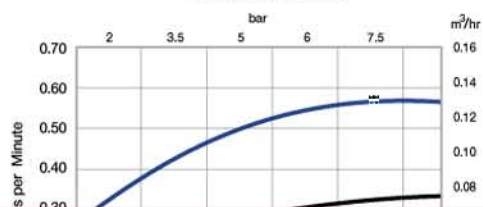

Injector "J" (Light Blue)  
For 10-inch Tanks

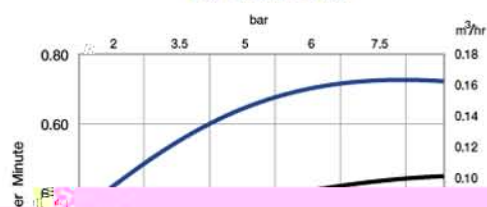

Injector "I" (Light Purple)  
For 9-inch Tanks



Injector "K" (Light Blue)  
For 10-inch Tanks

